



NOTE:  
CONTRACTOR AND/OR OWNER TO VERIFY ALL  
CONDITIONS, DIMENSIONS, AND DETAILS BEFORE  
COMMENCEMENT OF CONSTRUCTION.

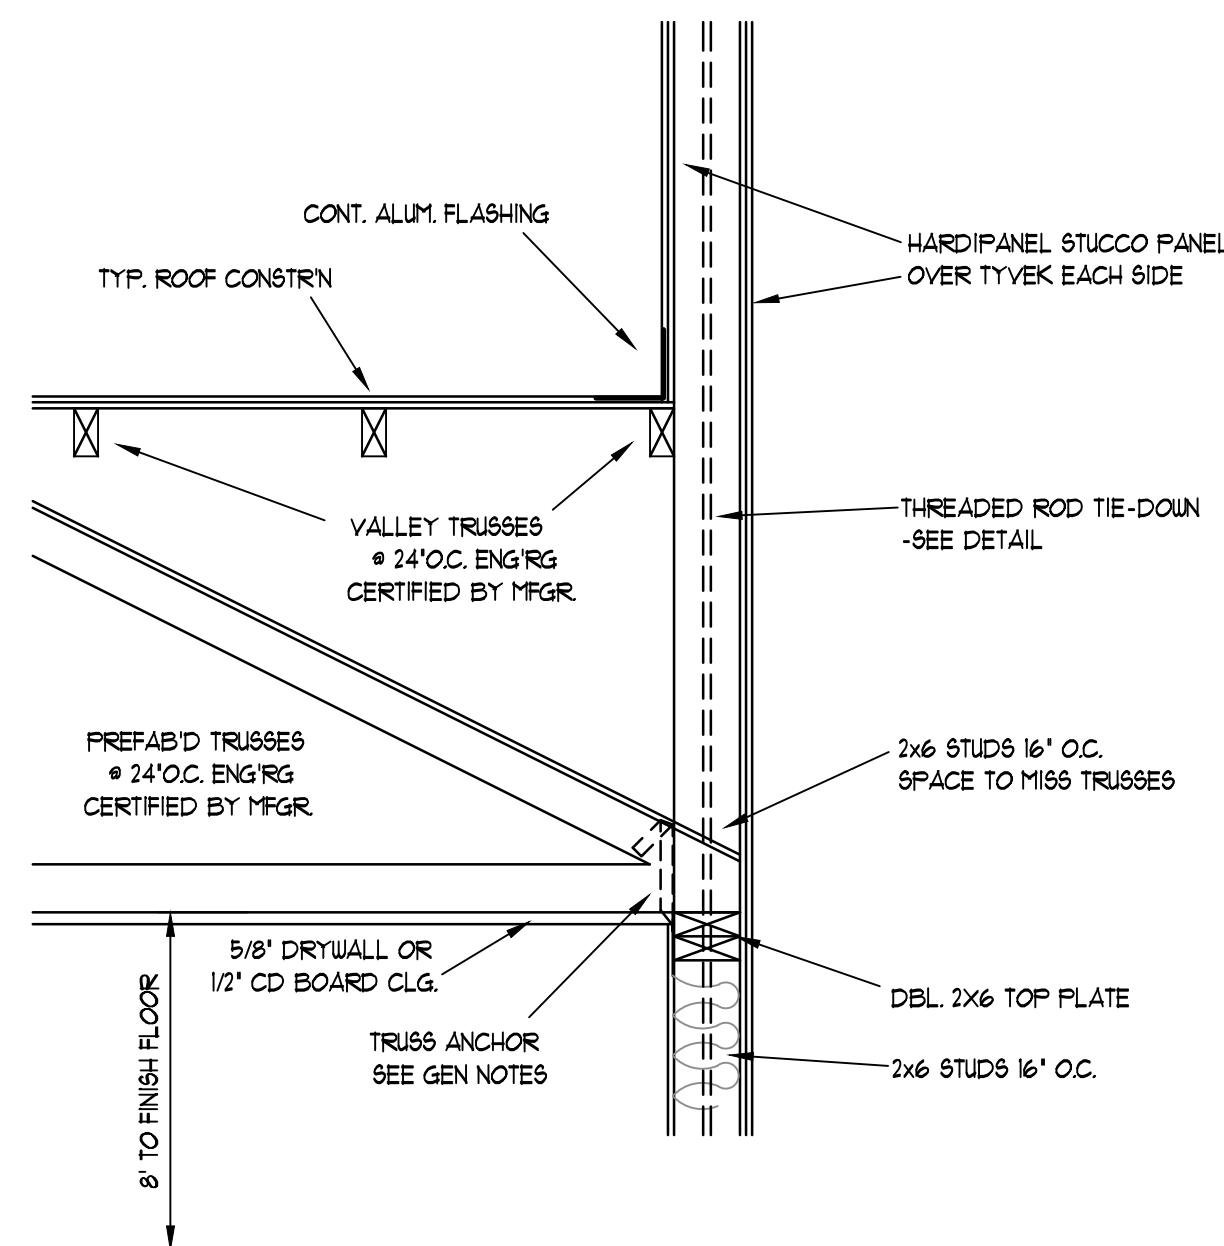


DBL BEARING SECTION Z  
SCALE: 3/4" = 1'-0"

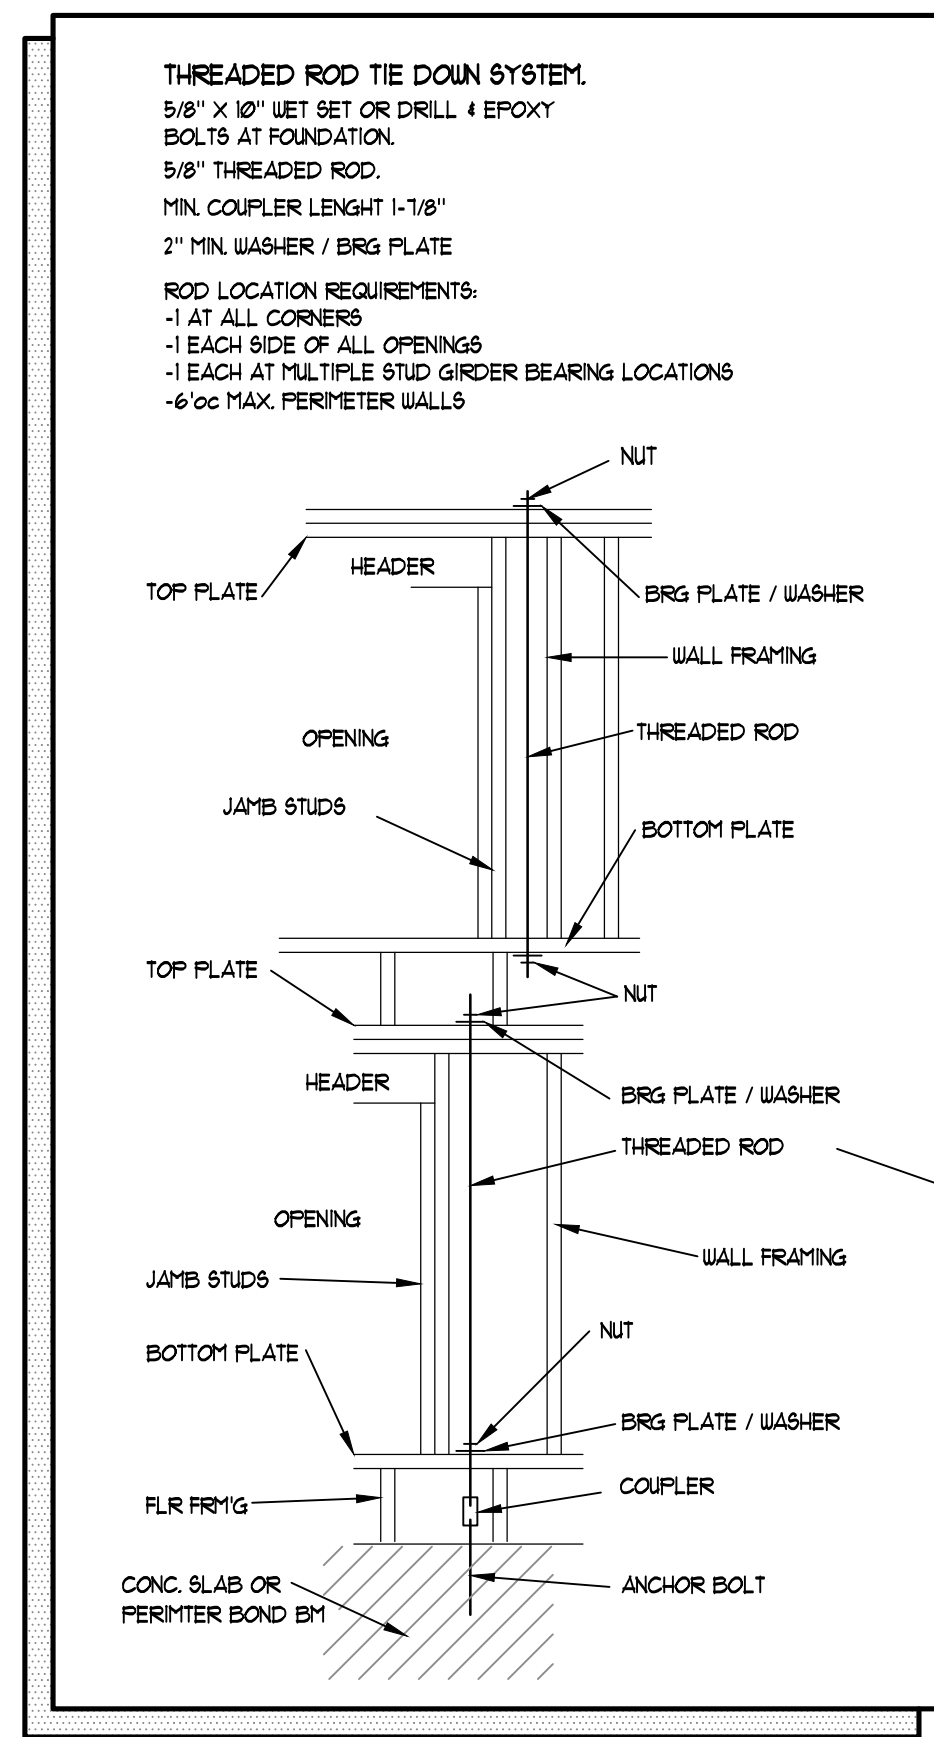

## 2nd. FLOOR PLAN

SCALE = 1/4"=1'-0"

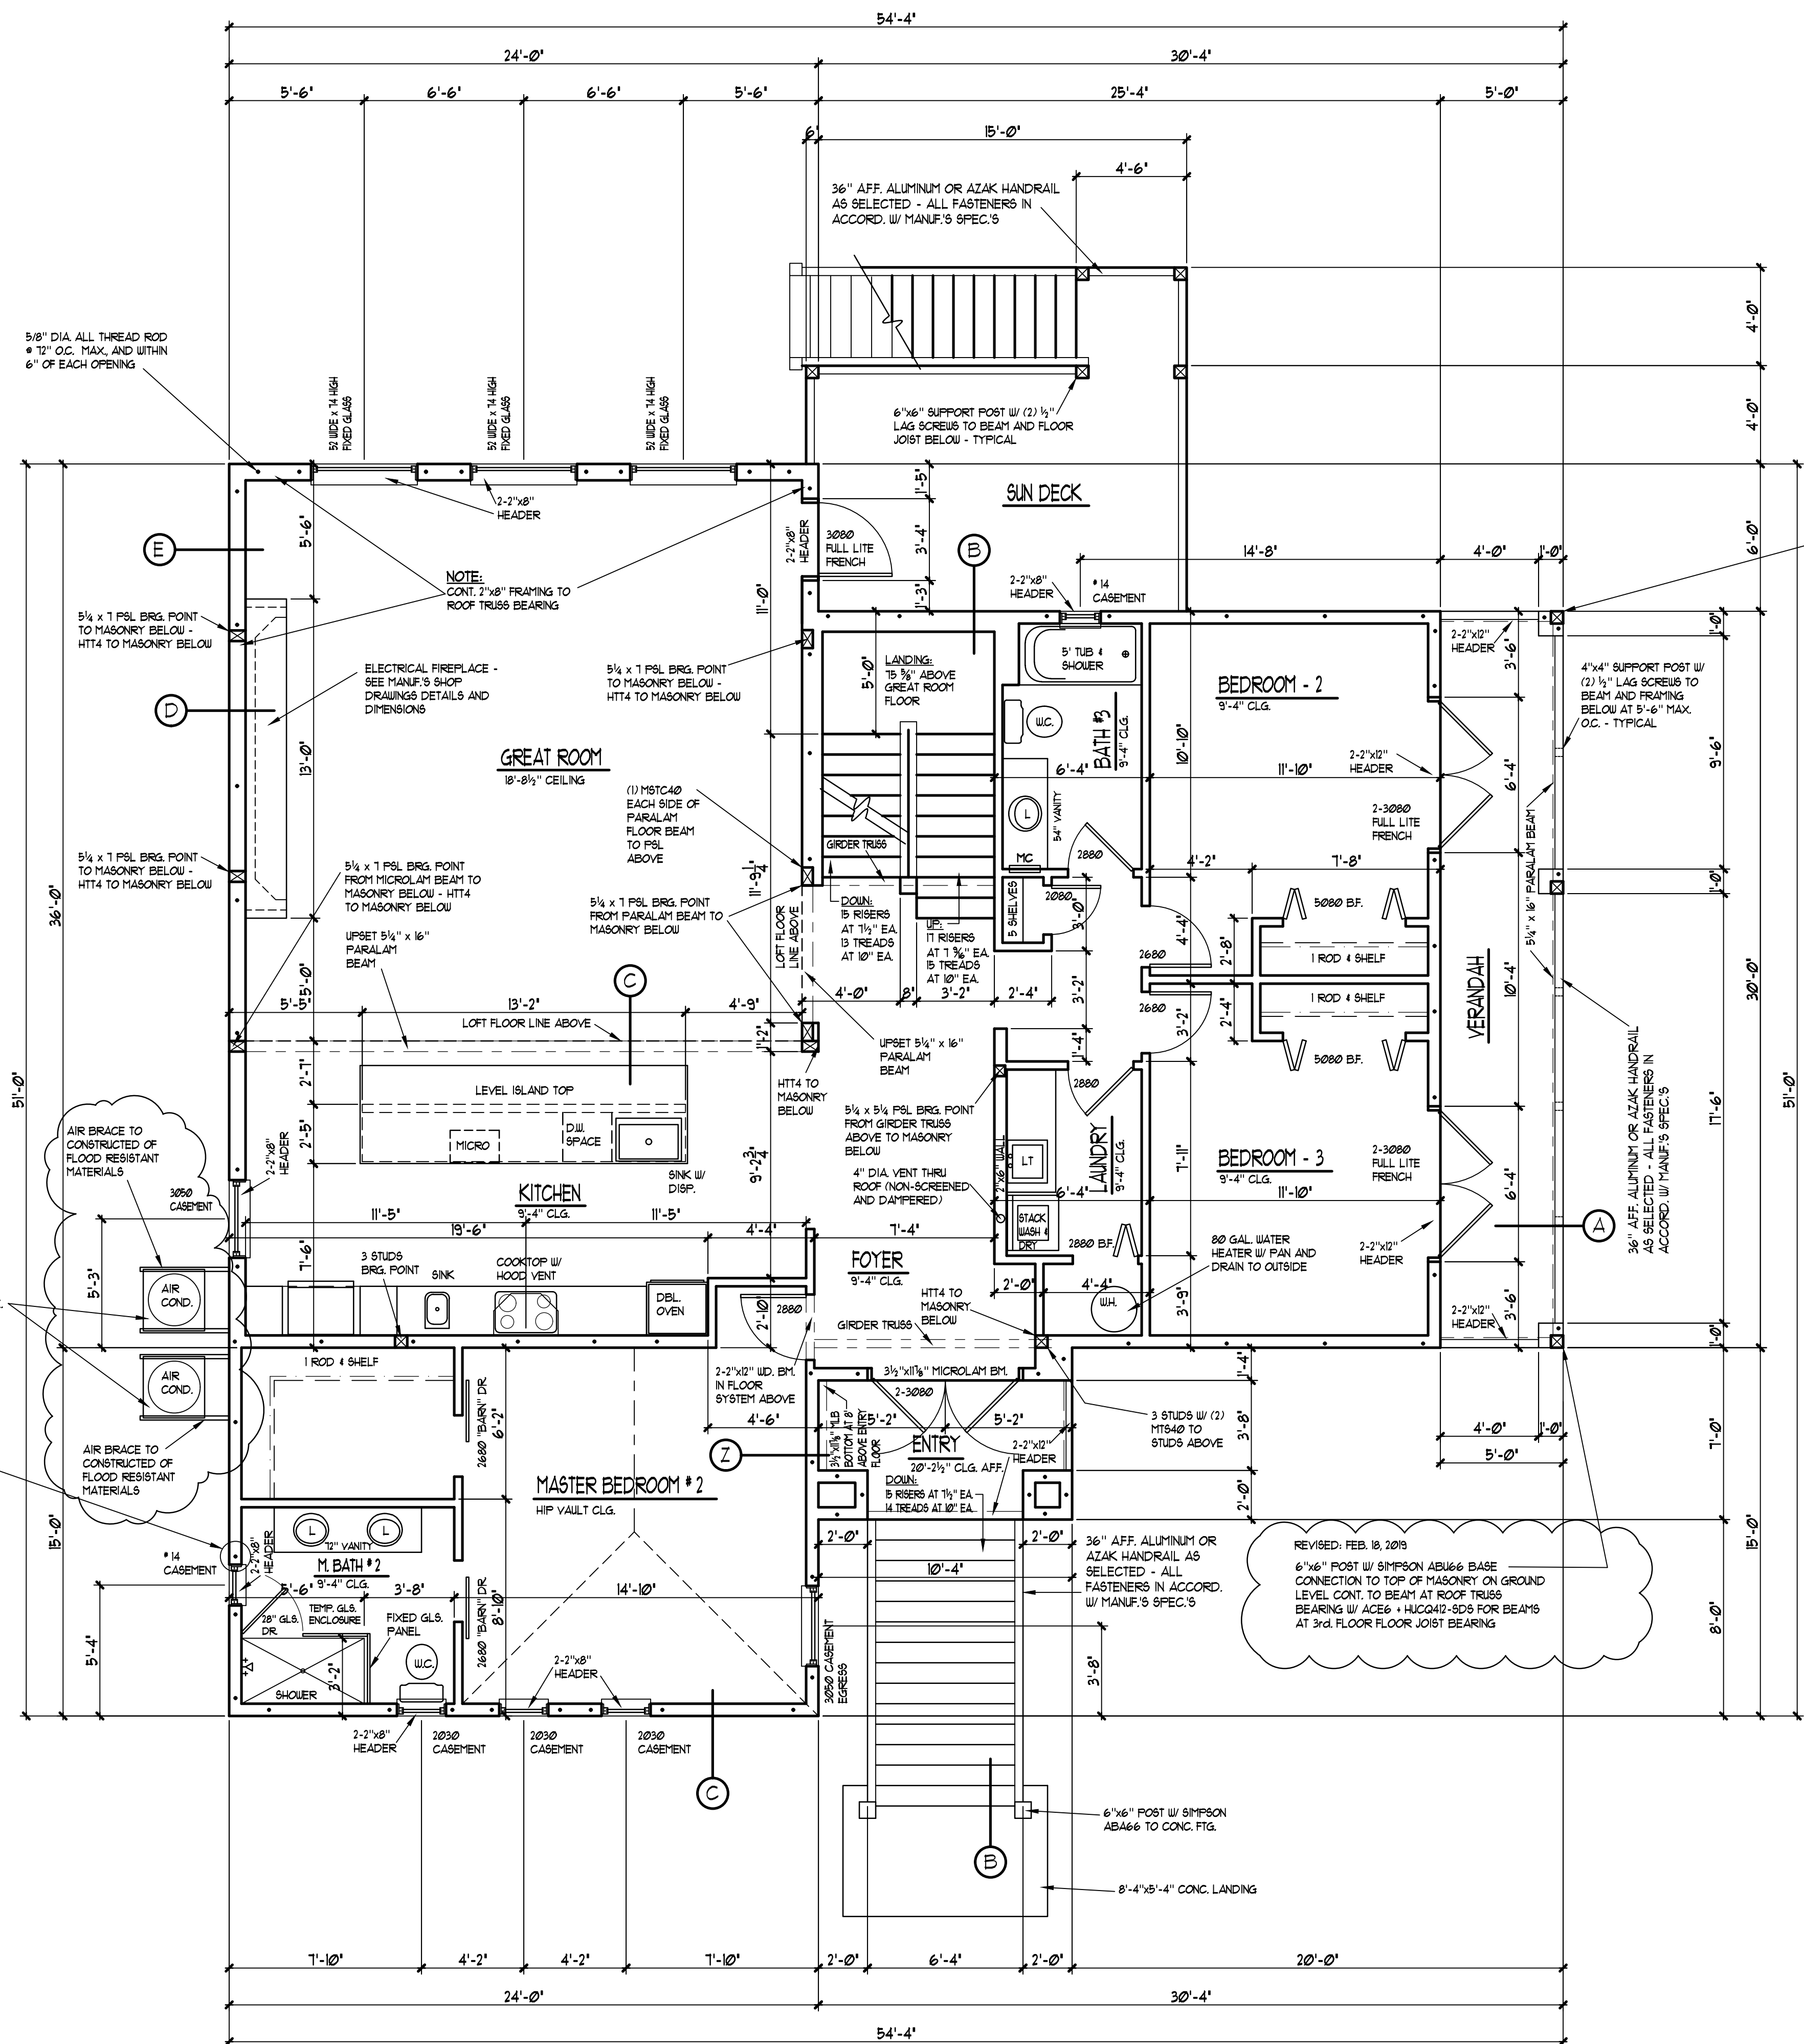

CEILING EXPOSED TO WIND:  
ENTRY, LANAI, PATIO, AND VERANDAH  
CEILING EXPOSED TO WIND TO BE 5/8"  
DENGLASS OR APPROVED SOFFIT BOARD  
ATTACHED TO BOTTOM CHORDS W/ 1/2"  
DRYWALL SCREWS AT 6" O.C. EDGES AND  
FIELD

REVISED: FEB. 18, 2019

6"x6" POST W/ SIMPSON ABL66 BASE  
CONNECTION TO TOP OF MASONRY ON GROUND  
LEVEL CONT. TO BEAM AT ROOF TRUSS  
BEARING W/ ACES + HUGO40-SDS FOR BEAMS  
AT 3RD FLOOR FLOOR JOIST BEARING